


Sharps disposal guide



NO FREE LIQUIDS

Do not use sharps units for the disposal of free liquids.

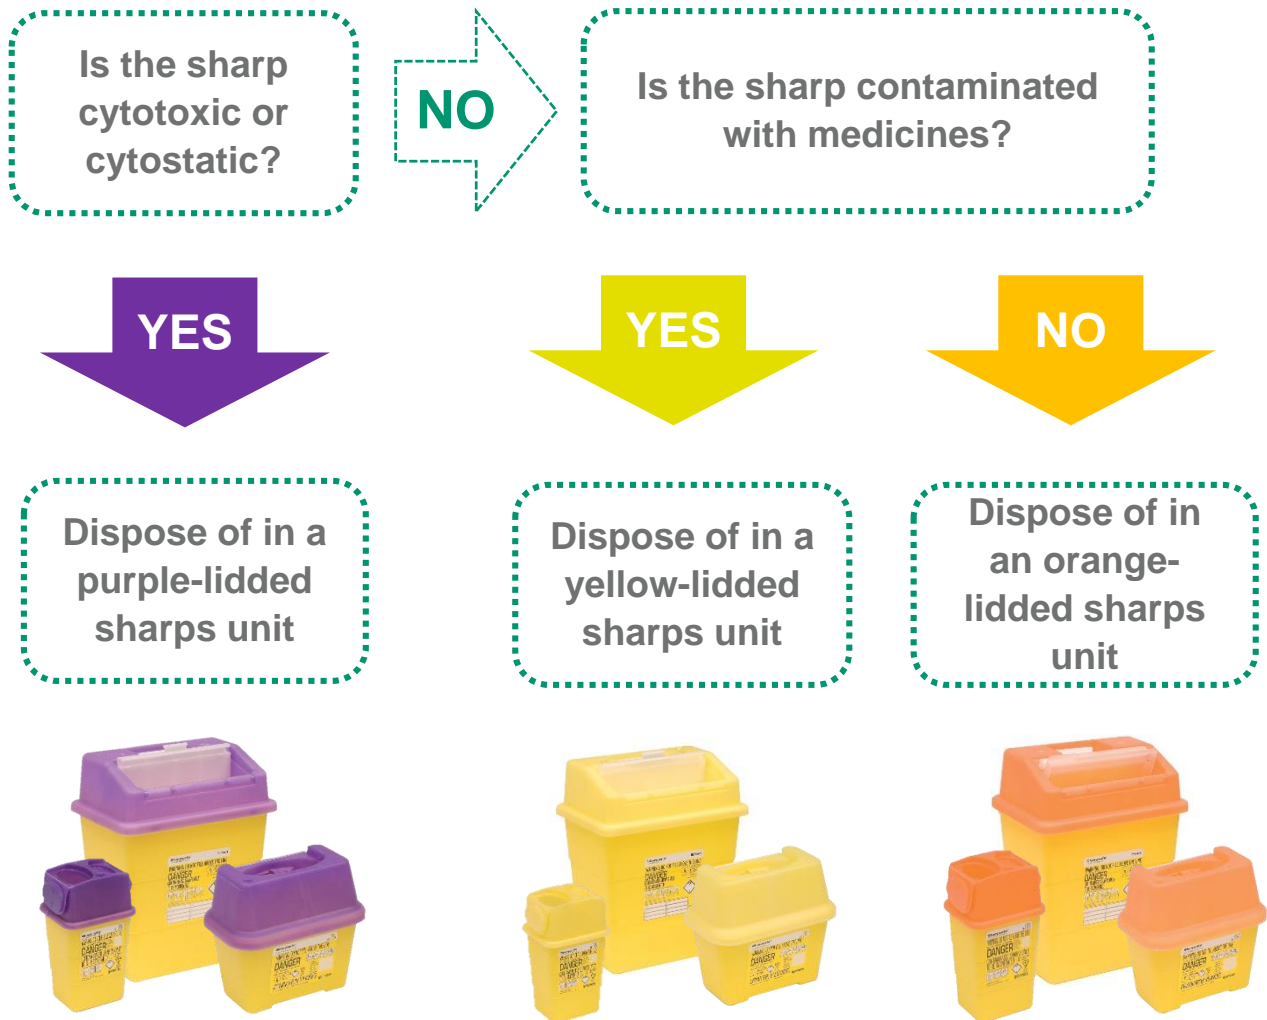

Sharps units should be filled to maximum of three-quarters full OR to the fill-line marked on the container, whichever is reached first.